


OFFICE



INFRARED HEATING REQUIREMENTS

1. (2) ETS80-30 VENTED SPACE-RAY INFRARED HEATERS, INSTALL AT 14 FT. ABOVE FINISHED FLOOR.
2. (1) SPACE-RAY SETBACK 5000 THERMOSTATS MOUNTED 56" ABOVE FINISHED FLOOR.
3. HEATERS SHALL BE "PULL THROUGH" SYSTEMS (VACUUM) WITH CAST IRON BURNER AND CALORIZED EMITTER TUBES.
4. HEATER, THERMOSTAT LOCATIONS SUBJECT TO FIELD VERIFICATION & COORDINATED WITH OTHER EQUIPMENT IN THE BUILDING.
5. CONSULT HEATER SPECIFICATION SHEET AND I & O INSTRUCTIONS. FOR FURTHER INFORMATION PLEASE VISIT WWW.SPACE-RAY.COM

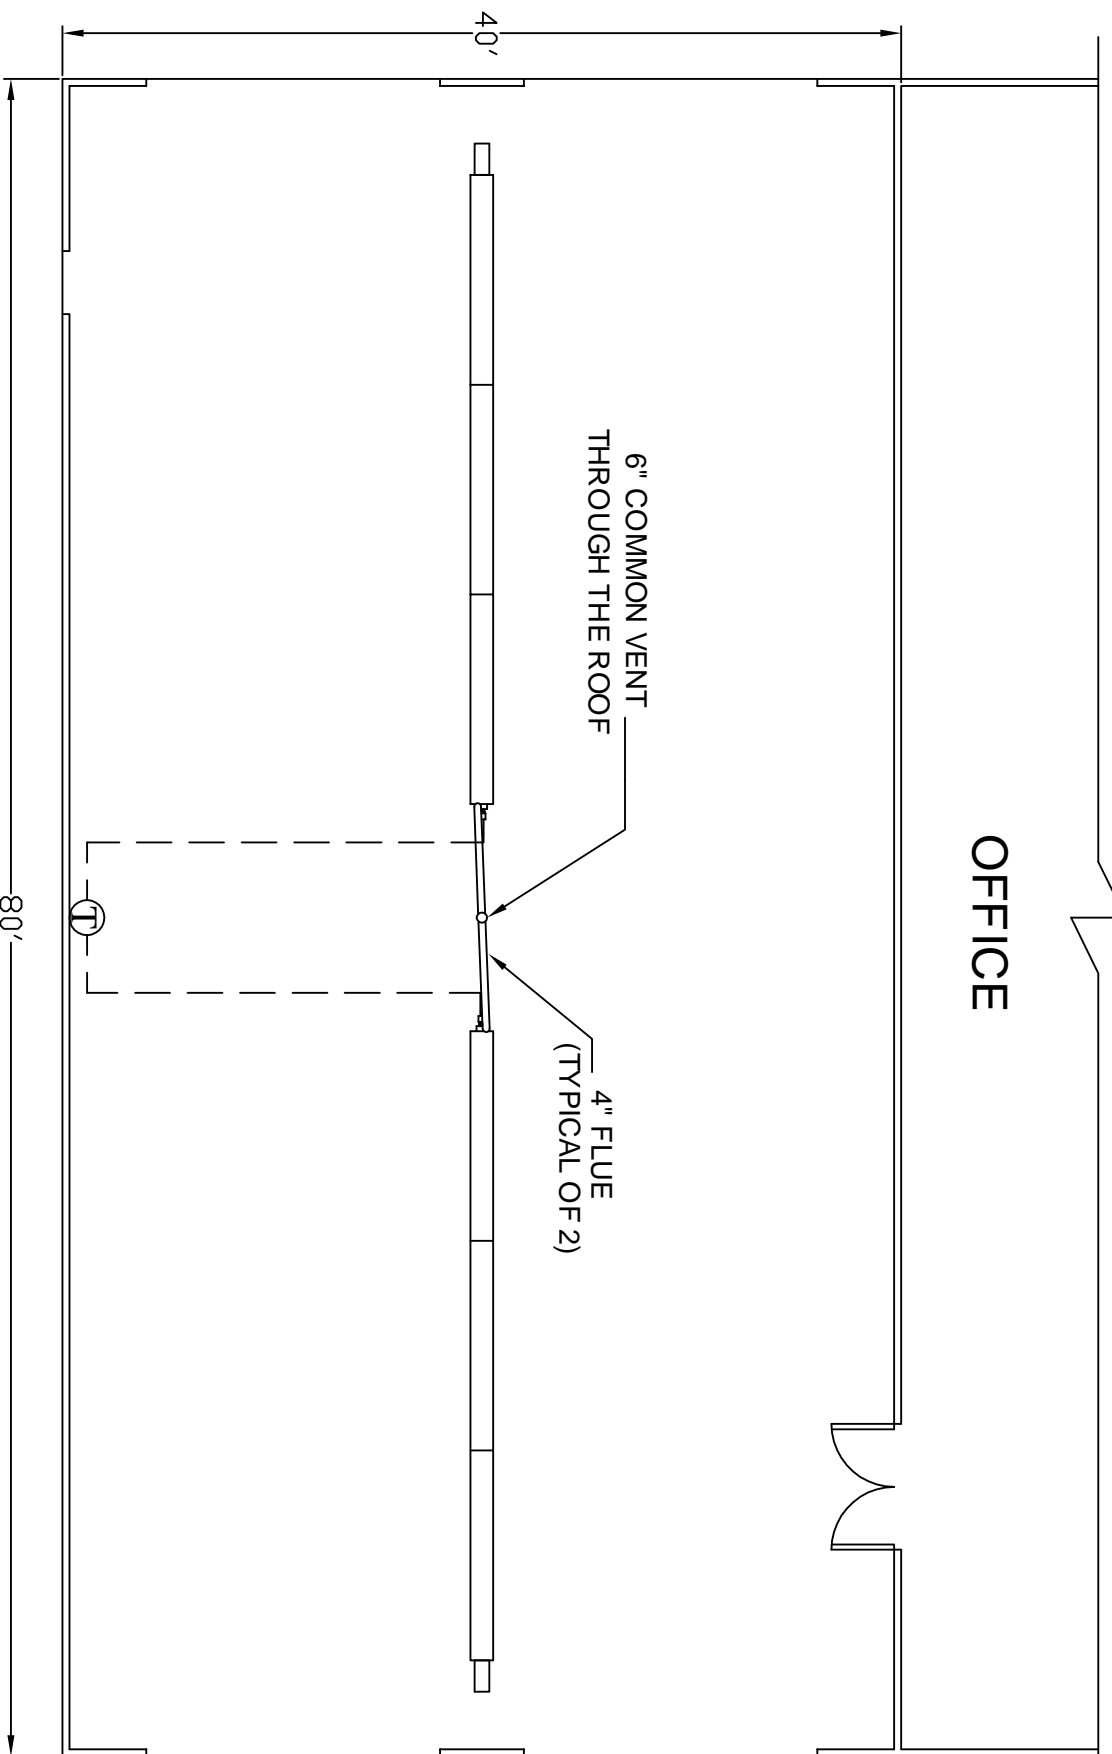

SPACE-RAY
INFRARED GAS HEATERS

Title: 4 - BAY FIRE STATION
INSTALLATION DETAIL-972

Drawn By: R.J. Harrington Date: 24 MAY 06