


TOP VIEW

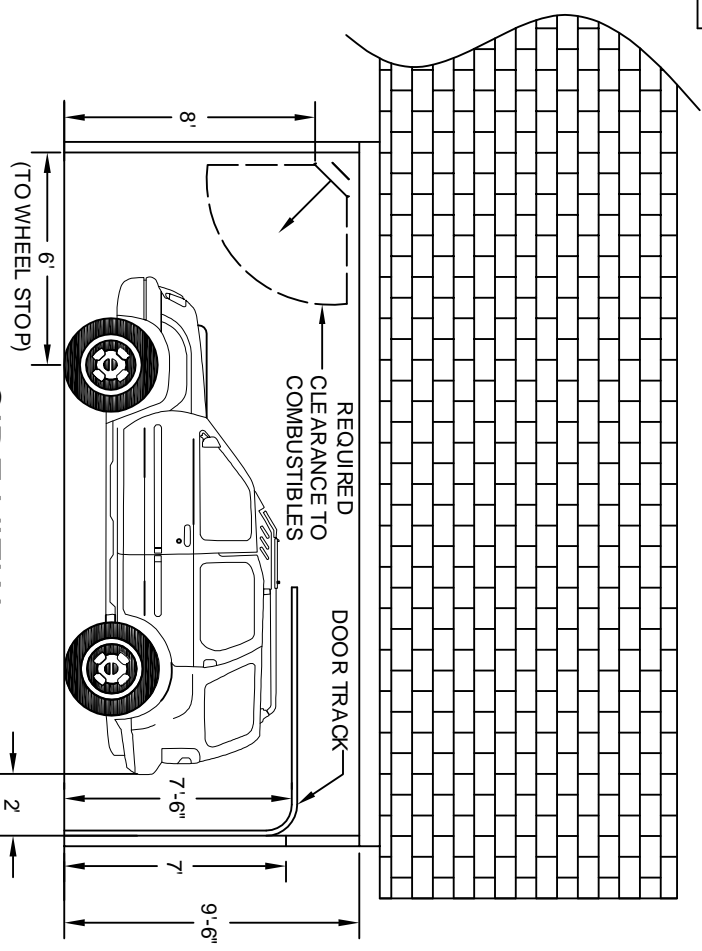

SIDE VIEW

INFRARED HEATING REQUIREMENTS

1. (1) CB50-NS VENTED SPACE-RAY INFRARED HEATER. INSTALL AT 8 FT. ABOVE FINISHED FLOOR.
2. (1) SPACE-RAY SETBACK 5000 THERMOSTAT MOUNTED 5'-6" ABOVE FINISHED FLOOR.
3. HEATER SHALL BE "PULL THROUGH" SYSTEMS (VACUUM) WITH CAST IRON BURNER AND CALORIZED EMITTER TUBES.
4. HEATER, THERMOSTAT LOCATIONS SUBJECT TO FIELD VERIFICATION & COORDINATED WITH OTHER EQUIPMENT IN THE BUILDING.
5. CONSULT HEATER SPECIFICATION SHEET AND I & O INSTRUCTIONS. FOR FURTHER INFORMATION PLEASE VISIT WWW.SPACERAY.COM
6. HEATER TO BE ROOF VENTED.
7. INSTALL PROPER SECOND STAGE REGULATORS AND VENTS IF ABOVE 1/2PSIG GAS SUPPLY.



Title: COLD BLOCKER INSTALLATION DETAIL
TWO CAR GARAGE
BRIAN KITCHENER RESIDENCE - 958

Drawn By: R.J. Harrington Date: 05 JUL 06